


METER 1" OR UNDER SUPPLIED BY NA WATER DEPT. AT THE COST OF THE APPLICANT

PLASTIC PLATFORM

*COVER TO FINISH GRADE

CAST IRON SIDE LOCKING LID W/2" CENTER HOLE FOR ELECTRONIC READING DEVICE (READING DEVICE SUPPLIED BY NA WATER DEPT.) COVER SHALL BE BROUGHT TO FINISH GRADE

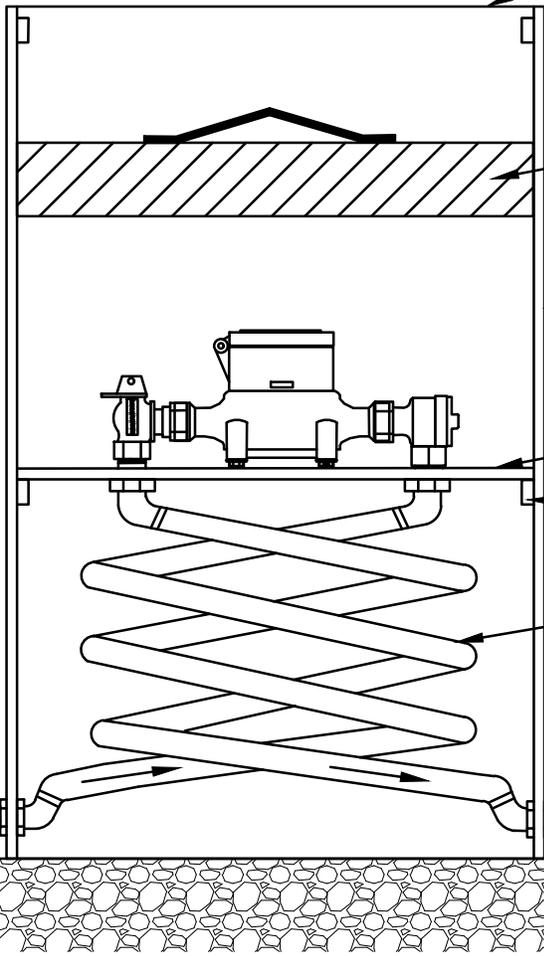

18"X4" INSULATING PAD

18"ØX60"(H) PLASTIC COIL METER PIT (AS SUPPLIED BY MUELLER CO. - OR APPROVED EQUAL)

STABILIZING PLATFORM

PLATFORM SUPPORT RING

1" COILS

1" MIP INLET & OUTLET CONNECTIONS

SET ON MIN. 6" OF 3/4"-1 1/2" CRUSHED STONE

NOTES:

1. ANY DEVIATIONS FROM THIS DETAIL MUST FIRST BE APPROVED BY NORTH ATTLEBORO WATER DEPT.
2. METER PITS SHALL BE REQUIRED WHERE SERVICE LINES ARE GREATER THAN 125 FEET LONG (FROM CURB STOP TO METER)
4. PITS DESIGNED IN PAVED AREAS MUST BE DESIGNED FOR H-20 LOADING



TOWN OF NORTH ATTLEBOROUGH, MASSACHUSETTS
DEPARTMENT OF PUBLIC WORKS

Date Last Updated:
01/09/2024

TYPICAL METER PIT DETAIL

N.T.S.

Detail Number:
W-8.1